


# SIEMENS

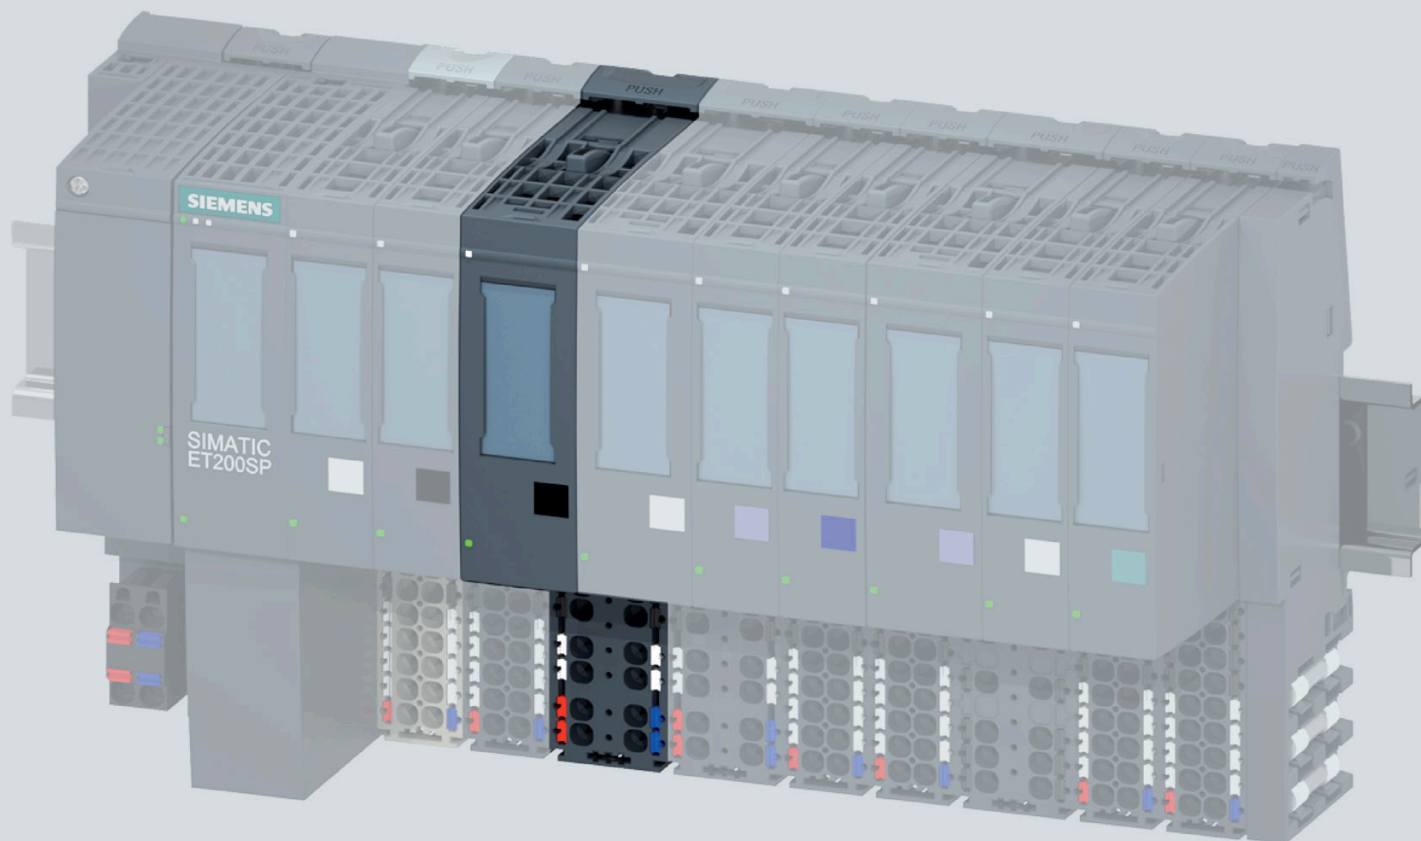

Manual

## SIMATIC

### ET 200SP

Digital output module  
RQ 4x120VDC-230VAC/5A NO ST  
(6ES7132-6HD01-0BB1)

Edition

06/2020

[support.industry.siemens.com](https://support.industry.siemens.com)

## SIMATIC

### ET 200SP Digital output module RQ 4x120VDC-230VAC/5A NO ST (6ES7132-6HD01-0BB1)

Equipment Manual

#### Preface

---

ET 200SP Documentation  
Guide

1

Product overview

2

Wiring up

3

Parameters/address space

4

Interrupts/diagnostics  
alarms

5

Technical specifications

6




Parameter data record

A

## Legal information

### Warning notice system

This manual contains notices you have to observe in order to ensure your personal safety, as well as to prevent damage to property. The notices referring to your personal safety are highlighted in the manual by a safety alert symbol, notices referring only to property damage have no safety alert symbol. These notices shown below are graded according to the degree of danger.

 <b>DANGER</b>
indicates that death or severe personal injury <b>will</b> result if proper precautions are not taken.
 <b>WARNING</b>
indicates that death or severe personal injury <b>may</b> result if proper precautions are not taken.
 <b>CAUTION</b>
indicates that minor personal injury can result if proper precautions are not taken.
<b>NOTICE</b>
indicates that property damage can result if proper precautions are not taken.


If more than one degree of danger is present, the warning notice representing the highest degree of danger will be used. A notice warning of injury to persons with a safety alert symbol may also include a warning relating to property damage.

### Qualified Personnel

The product/system described in this documentation may be operated only by **personnel qualified** for the specific task in accordance with the relevant documentation, in particular its warning notices and safety instructions. Qualified personnel are those who, based on their training and experience, are capable of identifying risks and avoiding potential hazards when working with these products/systems.

### Proper use of Siemens products

Note the following:

 <b>WARNING</b>
Siemens products may only be used for the applications described in the catalog and in the relevant technical documentation. If products and components from other manufacturers are used, these must be recommended or approved by Siemens. Proper transport, storage, installation, assembly, commissioning, operation and maintenance are required to ensure that the products operate safely and without any problems. The permissible ambient conditions must be complied with. The information in the relevant documentation must be observed.

### Trademarks

All names identified by ® are registered trademarks of Siemens AG. The remaining trademarks in this publication may be trademarks whose use by third parties for their own purposes could violate the rights of the owner.

### Disclaimer of Liability

We have reviewed the contents of this publication to ensure consistency with the hardware and software described. Since variance cannot be precluded entirely, we cannot guarantee full consistency. However, the information in this publication is reviewed regularly and any necessary corrections are included in subsequent editions.

# Preface

## Purpose of the documentation

This manual supplements the system manual ET 200SP distributed I/O system (<http://support.automation.siemens.com/WW/view/en/58649293>).

Functions that generally relate to the system are described in this manual.

The information provided in this manual and in the system/function manuals supports you in commissioning the system.

## Changes compared to previous version

Compared to the previous version, this manual contains the following change:

- Wiring and block diagram for current measurement 2-wire and 4-wire connection has been changed.
- The technical specifications have been updated.

## Conventions

CPU: When the term "CPU" is used in this manual, it applies to the CPUs of the S7-1500 automation system as well as to the CPUs/interface modules of the distributed I/O system ET 200SP.

STEP 7: In this documentation, "STEP 7" is used as a synonym for all versions of the configuration and programming software "STEP 7 (TIA Portal)".

Please also observe notes marked as follows:

---

### Note

A note contains important information on the product described in the documentation, on the handling of the product or on the section of the documentation to which particular attention should be paid.

---

## Recycling and disposal

For environmentally friendly recycling and disposal of your old equipment, contact a certified electronic waste disposal company and dispose of the equipment according to the applicable regulations in your country.

## Security information

Siemens provides products and solutions with industrial security functions that support the secure operation of plants, systems, machines and networks.

In order to protect plants, systems, machines and networks against cyber threats, it is necessary to implement – and continuously maintain – a holistic, state-of-the-art industrial security concept. Siemens' products and solutions constitute one element of such a concept.

Customers are responsible for preventing unauthorized access to their plants, systems, machines and networks. Such systems, machines and components should only be connected to an enterprise network or the internet if and to the extent such a connection is necessary and only when appropriate security measures (e.g. firewalls and/or network segmentation) are in place.

For additional information on industrial security measures that may be implemented, please visit (<https://www.siemens.com/industrialsecurity>).

Siemens' products and solutions undergo continuous development to make them more secure. Siemens strongly recommends that product updates are applied as soon as they are available and that the latest product versions are used. Use of product versions that are no longer supported, and failure to apply the latest updates may increase customers' exposure to cyber threats.


To stay informed about product updates, subscribe to the Siemens Industrial Security RSS Feed visit (<https://www.siemens.com/industrialsecurity>).

# Table of contents

	<b>Preface .....</b>	<b>3</b>
<b>1</b>	<b>ET 200SP Documentation Guide .....</b>	<b>6</b>
<b>2</b>	<b>Product overview .....</b>	<b>8</b>
	2.1 Properties .....	8
<b>3</b>	<b>Wiring up .....</b>	<b>10</b>
	3.1 Wiring and block diagram .....	10
<b>4</b>	<b>Parameters/address space .....</b>	<b>13</b>
	4.1 Parameters .....	13
	4.2 Explanation of the parameters .....	14
	4.3 Address space .....	14
<b>5</b>	<b>Interrupts/diagnostics alarms .....</b>	<b>16</b>
	5.1 Status and error display.....	16
	5.2 Interrupts .....	18
	5.3 Diagnostics alarms.....	18
<b>6</b>	<b>Technical specifications.....</b>	<b>19</b>
	6.1 Technical specifications .....	19
	6.2 Switching cycles .....	24
<b>A</b>	<b>Parameter data record .....</b>	<b>25</b>
	A.1 Parameter assignment and structure of the parameter data record .....	25

The documentation for the SIMATIC ET 200SP distributed I/O system is arranged into three areas.

This arrangement enables you to access the specific content you require.

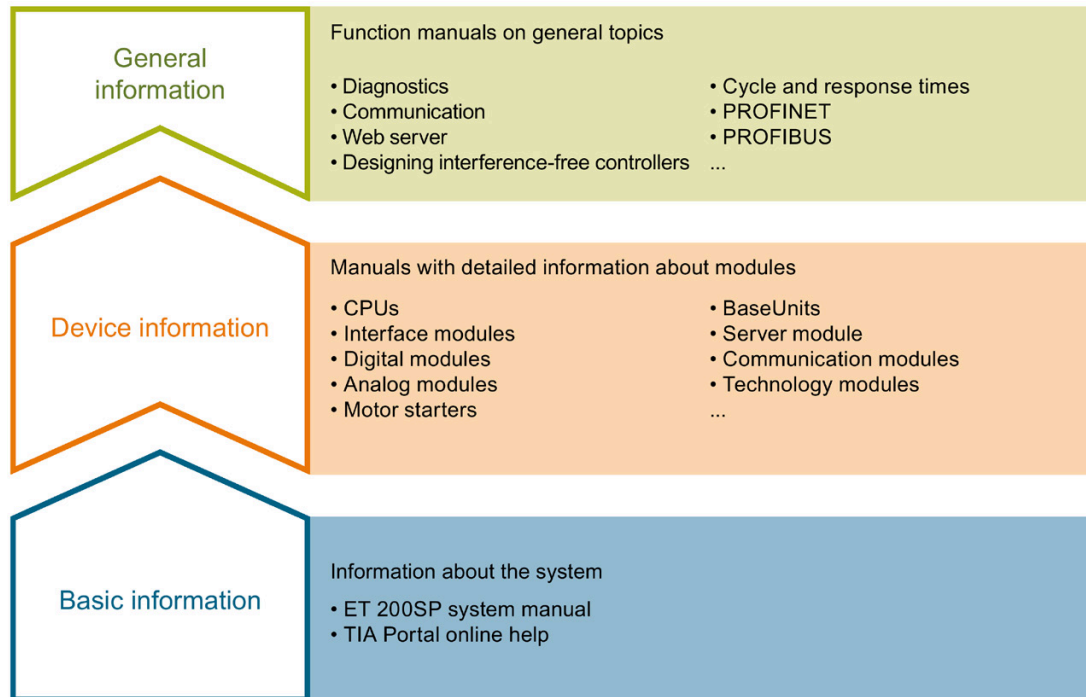

## Basic information

The System Manual and Getting Started describe in detail the configuration, installation, wiring and commissioning of the SIMATIC ET 200SP distributed I/O system. The STEP 7 online help supports you in the configuration and programming.

## Device information

Product manuals contain a compact description of the module-specific information, such as properties, wiring diagrams, characteristics and technical specifications.

### General information

The function manuals contain detailed descriptions on general topics regarding the SIMATIC ET 200SP distributed I/O system, e.g. diagnostics, communication, Web server, motion control and OPC UA.

You can download the documentation free of charge from the Internet (<https://support.industry.siemens.com/cs/ww/en/view/109742709>).

Changes and supplements to the manuals are documented in a Product Information.

You can download the product information free of charge from the Internet (<https://support.industry.siemens.com/cs/us/en/view/73021864>).

### Manual Collection ET 200SP

The Manual Collection contains the complete documentation on the SIMATIC ET 200SP distributed I/O system gathered together in one file.

You can find the Manual Collection on the Internet (<https://support.automation.siemens.com/WW/view/en/84133942>).

### "mySupport"

With "mySupport", your personal workspace, you make the most of your Industry Online Support.

In "mySupport" you can store filters, favorites and tags, request CAx data and put together your personal library in the Documentation area. Furthermore, your data is automatically filled into support requests and you always have an overview of your current requests.

You need to register once to use the full functionality of "mySupport".

You can find "mySupport" in the Internet (<https://support.industry.siemens.com/My/ww/en>).

### Application examples

The application examples support you with various tools and examples for solving your automation tasks. Solutions are shown in interplay with multiple components in the system - separated from the focus in individual products.

You can find the application examples on the Internet (<https://support.industry.siemens.com/sc/ww/en/sc/2054>).



## Product overview

### 2.1 Properties

#### Article number

6ES7132-6HD01-0BB1 (number in package unit: 1 unit)

6ES7132-6HD01-2BB1 (number in package unit: 10 units)

#### View of the module

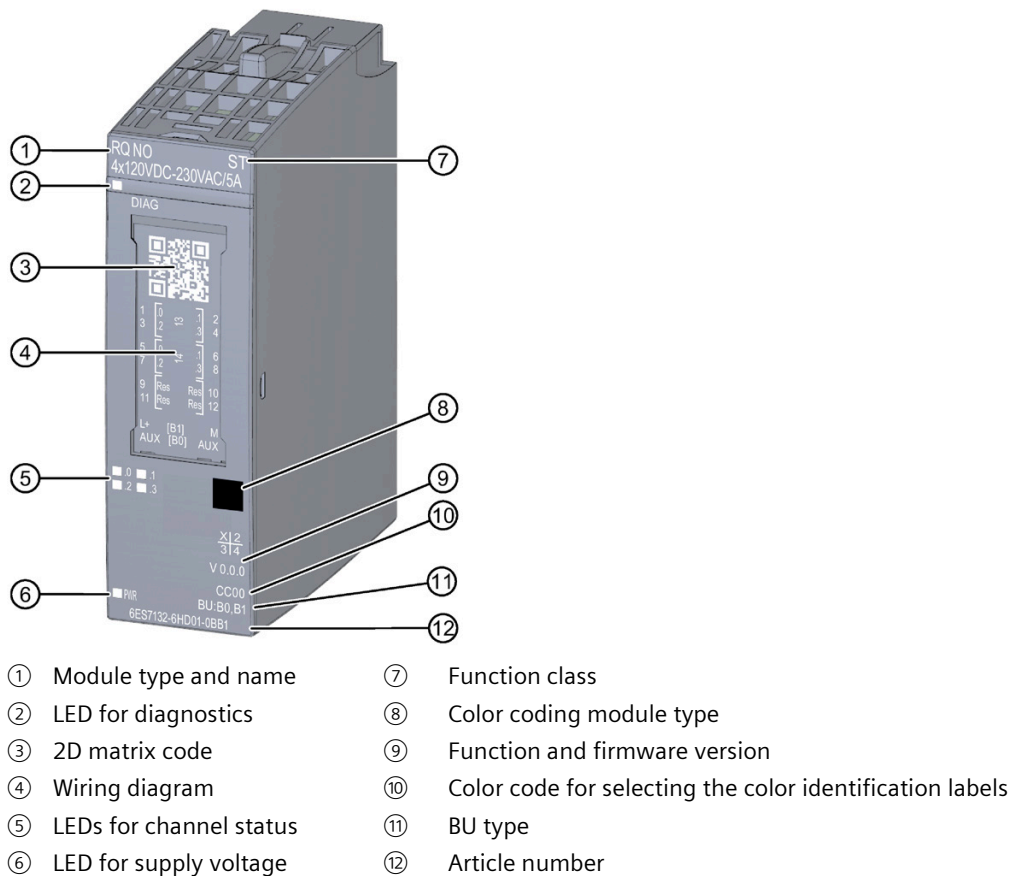


Figure 2-1 View of the RQ 4x120VDC-230VAC/5A NO ST module

## Properties

The module has the following technical properties:

- Digital output module with 4 floating relay outputs
- Supply voltage L+
- Output current per output 5 A
- Normally open contact (NO: normally open)
- Configurable diagnostics (per module)
- Configurable substitute values (per channel)
- Suitable for solenoid valves, DC contactors, and indicator lights

The module supports the following functions:

Table 2- 1 Version dependencies of the functions

Function	HW version	FW version	STEP 7		GSD file	
			TIA Portal	V5.x	PROFINET IO	PROFIBUS DP
Identification data I&M0 to I&M3	FS01	V0.0.0 and higher	V14 or higher with HSP 0222	V5.5 SP3 or higher with HSP 0232 V7.0	X	X
Configuration in RUN	FS01	V0.0.0 and higher	V14 or higher with HSP 0222	V5.5 SP3 or higher with HSP 0232 V7.0	X	X
PROFenergy	FS01	V0.0.0 and higher	V14 or higher with HSP 0222	V5.5 SP3 or higher with HSP 0232 V7.0	X	X
Value status	FS01	V0.0.0 and higher	V14 or higher with HSP 0222	V5.5 SP3 or higher with HSP 0232 V7.0	X	X

## Accessories

The following accessories must be ordered separately:

- Labeling strips
- Color identification labels
- Reference identification label
- Shield connector

## See also

You can find more information on accessories in the ET 200SP distributed I/O system (<http://support.automation.siemens.com/WW/view/en/58649293>) system manual.

## Wiring up

### 3.1 Wiring and block diagram

This section includes the block diagram of the RQ 4x120VDC-230VAC/5A NO ST module with the terminal assignments for 2-wire and 3-wire connection.

You can find information on wiring the BaseUnit in the ET 200SP distributed I/O system (<http://support.automation.siemens.com/WW/view/en/58649293>) system manual.

---

**Note**

You may use and combine the different wiring options for all channels.

---


---

**Note**

- The relay contacts of the module can only switch identical voltage potential.
  - The AUX terminals of the self-assembling voltage bus can be used for the connection of the protective conductor (PE) or for the same voltages up to a maximum of 24 V DC.
-

### Connection: 3-wire connection of actuators

The following figure shows the block diagram and an example for the terminal assignment of the digital output module RQ 4x120VDC-230VAC/5A NO ST on the BaseUnit BU type B0.

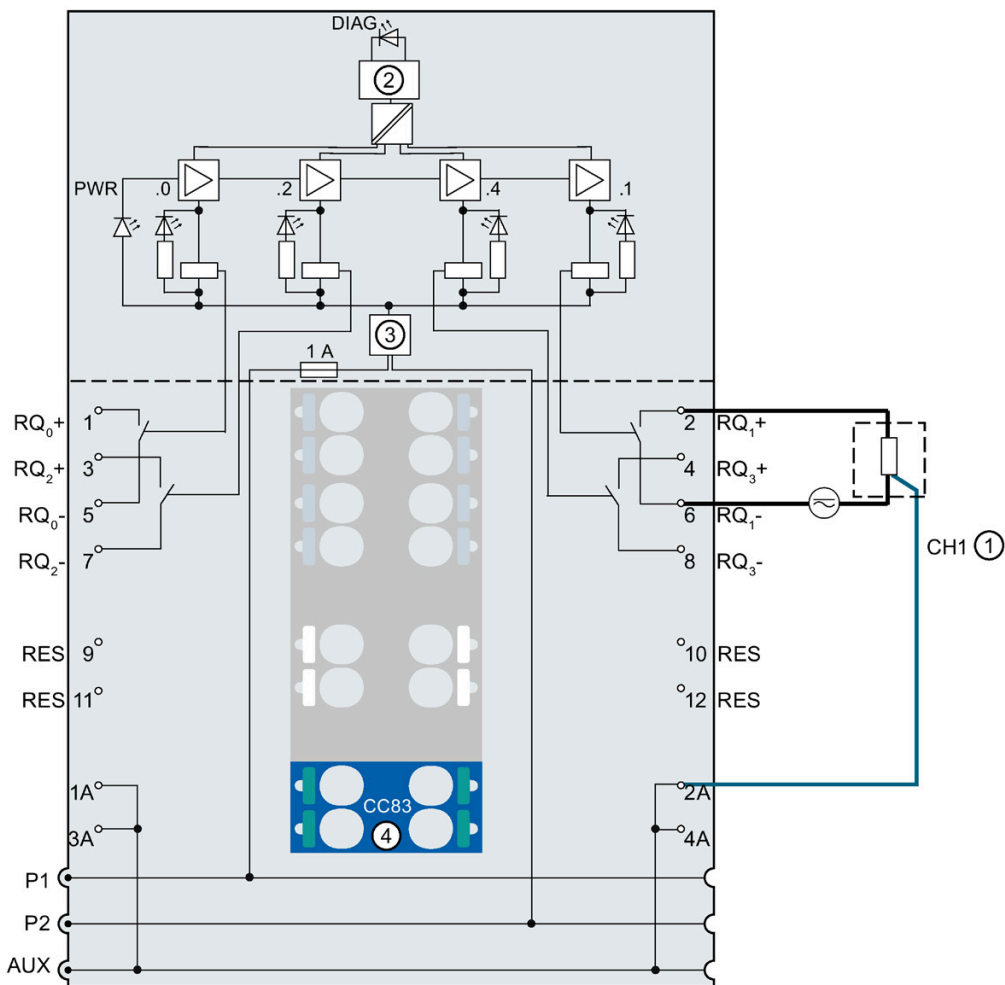


①	3-wire connection	RES	Reserve, must remain unused for future function extensions
②	Backplane bus interface	1A to 4A	AUX terminals
③	Polarity reversal protection	DIAG	Diagnostics LED (green, red)
④	Color identification label CCxx (optional)	.0, .1, .2, .3	Channel status LED (green)
RQ <sub>n</sub> +, RQ <sub>n</sub> -	Channel n	PWR	Power LED (green)
P1, P2, AUX	Internal self-assembling voltage buses Connection to left (dark-colored BaseUnit)		

Figure 3-1 Wiring and block diagram for 3-wire connection of actuators

### Connection: 2-wire connection of actuators

The following figure shows the block diagram and an example for the terminal assignment of the digital output module RQ 4x120VDC-230VAC/5A NO ST on the BaseUnit BU type B1.

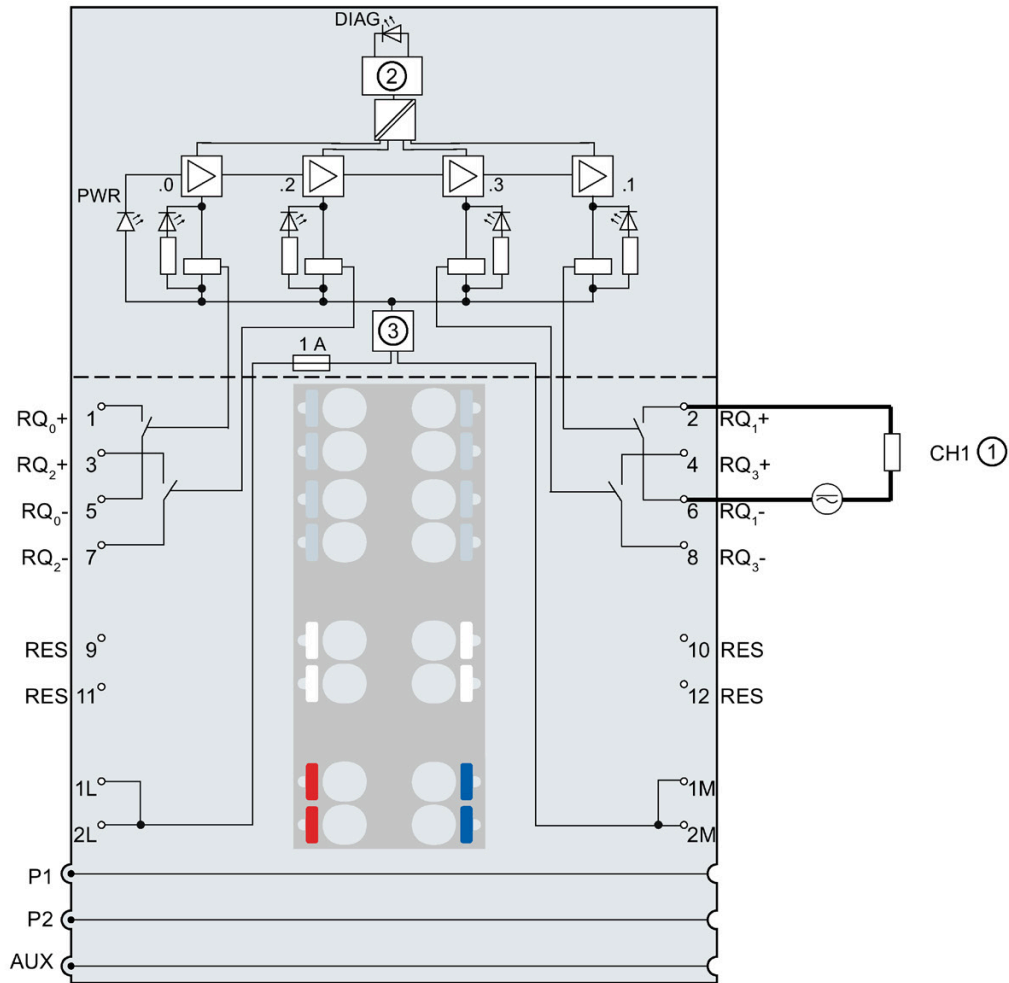

①	2-wire connection	1L, 2L	24 V DC supply voltage
②	Backplane bus interface	1M, 2M	Ground
③	Polarity reversal protection	DIAG	Diagnostics LED (green, red)
RQ <sub>n</sub>	Channel n	.0, .1, .2, .3	Channel status LED (green)
+			
RQ <sub>n</sub> -			
RES	Reserve, must remain unused for future function extensions	PWR	Power LED (green)
		P1, P2, AUX	Internal self-assembling voltage buses Connection to left (dark-colored BaseUnit)

Figure 3-2 Wiring and block diagram for 2-wire connection of actuators

## Parameters/address space

### 4.1 Parameters

#### Parameters for RQ 4x120VDC-230VAC/5A NO ST

Specify the module properties with the various parameters in the course of your STEP 7 configuration. The following table lists the configurable parameters. The effective range of the parameters depends on the type of configuration.

The following configurations are possible:

- Central operation with an ET 200SP CPU
- Distributed operation on PROFINET IO in an ET 200SP system
- Distributed operation with PROFIBUS DP in an ET 200SP system

When assigning parameters in the user program, use the "WRREC" instruction to transfer the parameters to the module using the data records; refer to the section Parameter assignment and structure of the parameter data record (Page 25).

The following parameter settings are possible:

Table 4- 1 Settable parameters and their defaults (GSD file)

Parameter	Value range	Default	Configura- tion in RUN	Scope with configuration soft- ware, e.g. STEP 7 (TIA Portal)	
				GSD file PROFINET IO	GSD file PROFIBUS DP <sup>1</sup>
Diagnostics No supply voltage L+	<ul style="list-style-type: none"> <li>• Disable</li> <li>• Enable</li> </ul>	Disable	yes	Module	Module
Channel enabled	<ul style="list-style-type: none"> <li>• Disable</li> <li>• Enable</li> </ul>	Enable	yes	Channel	Channel
Reaction to CPU STOP	<ul style="list-style-type: none"> <li>• Turn off</li> <li>• Keep last value</li> <li>• Output substitute val- ue 1</li> </ul>	Turn off	yes	Channel	Module

<sup>1</sup> Due to the limited number of parameters of a maximum of 244 bytes per ET 200SP station with a PROFIBUS GSD configuration, the parameter assignment options are restricted. The parameter length of the I/O module is 4 bytes with PROFIBUS GSD configuration. If necessary, you can set this parameter by using the data record 128, see the appendix "Parameter data record".

## 4.2 Explanation of the parameters

### Diagnostics no supply voltage L+

Enabling of the diagnostics for no or insufficient supply voltage L+.

### Channel activated

Determines whether a channel is enabled or disabled.

### Reaction to CPU STOP

Specifies the behavior of the module if the CPU changes to STOP.

### See also

ET 200SP distributed I/O system

(<http://support.automation.siemens.com/WW/view/en/58649293>)

## 4.3 Address space

The module can be configured differently in STEP 7; see following table. Depending on the configuration, additional/different addresses are assigned in the process image of the inputs.

### Configuration options of RQ 4x120VDC-230VAC/5A NO ST

You can configure the module with STEP 7 (TIA Portal) or with a GSD file. If you configure the module using a GSD file, the configurations are available under various short designations/module names; see the table below. The following configurations are possible:

Table 4- 2 Configuration options with GSD file

Configuration	Short designation/module name in the GSD file	Configuration software, e.g. with STEP 7 (TIA Portal)		
		Integrated in hardware catalog STEP 7	GSD file PROFINET IO	GSD file PROFIBUS DP
1 x 4-channel without value status	RQ 4x120VDC-230VAC/5A NO ST V0.0	V14, SP1 or higher with HSP 0222	X	X
1 x 4-channel with value status	RQ 4x120VDC-230VAC/5A NO ST V0.0, QI	V14, SP1 or higher with HSP 0222	X	---

## Evaluating the value status

An additional byte is allocated in the input address space if you enable the value status for the digital module. Bits 0 to 3 in this byte are assigned to a channel. They provide information about the validity of the digital value.

Bit = 1: No fault is present on the channel.

Bit = 0: Channel is disabled or there is a fault/error on the module.

If a fault/error occurs on a channel with this module, the value status for all channels is 0.

## Address space

The following figure shows the assignment of the address space for the RQ 4x120VDC-230VAC/5A NO ST with value status (Quality Information (QI)). The addresses for the value status are only available if the value status is enabled.

Assignment in the process image output (PIQ)

	7	6	5	4	3	2	1	0	Output value
QB x	0	0	0	0					Channel 0 to 3

Assignment in the process image input (PII)

	7	6	5	4	3	2	1	0	Value status (QI)
IB x	0	0	0	0					Channel 0 to 3 (value status QI0 to QI3)

Figure 4-1 Address space of RQ 4x120VDC-230VAC/5A NO ST with value status



## Interrupts/diagnostics alarms

### 5.1 Status and error display

#### LED display

The figure below shows the LED displays (status and error displays) of the RQ 4x120VDC-230VAC/5A NO ST.

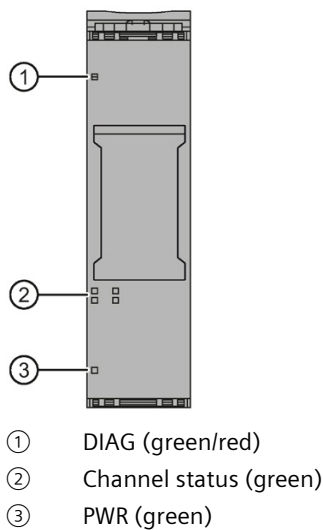






Figure 5-1 LED display

#### Meaning of the LED displays

The following tables show the meaning of the status and error displays. Measures for dealing with diagnostics alarms can be found in the section Diagnostics alarms (Page 18).



## DIAG LED

Table 5- 1 DIAG LED fault/error display

DIAG LED	Meaning
 off	Backplane bus supply of the ET 200SP not OK
 Flashes	Module not ready for operation (no parameters assigned)
 on	Module parameters assigned
 Flashes	Module diagnostics is available



## Channel status LED

Table 5- 2 Status display of the channel status LED

Channel status LED	Meaning
 off	Channel deactivated or activated and process signal = 0
 on	Channel activated and process signal = 1

## PWR LED

Table 5- 3 Status display of the PWR LED

PWR LED	Meaning
 off	No supply voltage L+
 on	Supply voltage L+ present

## 5.2 Interrupts

The RQ 4×120VDC-230VAC/5A NO ST digital output module supports diagnostic interrupts.

### Diagnostics interrupt

The module generates a diagnostics interrupt for the following events:

- Parameter assignment error
- No supply voltage

## 5.3 Diagnostics alarms

A diagnostic alarm is generated and the DIAG-LED flashes on the module for each diagnostics event. You can read out the diagnostics alarms, for example, in the diagnostics buffer of the CPU. You can evaluate the error codes with the user program.

Table 5- 4 Diagnostics alarms, their meanings and corrective measures

Diagnostics alarm	Error code	Meaning	Solution
Parameter assignment error	10 <sub>H</sub>	<ul style="list-style-type: none"><li>• The module cannot evaluate parameters for the channel.</li><li>• Incorrect parameter assignment.</li></ul>	Correct the parameter assignment
No supply voltage	11 <sub>H</sub>	No or insufficient supply voltage L+	<ul style="list-style-type: none"><li>• Check supply voltage L+ on the BaseUnit</li><li>• Check BaseUnit type</li></ul>

# Technical specifications

## 6.1 Technical specifications

### Technical specifications of RQ 4x120VDC-230VAC/5A NO ST

The following table shows the technical specifications as of 06/2020. You will find a data sheet including daily updated technical specifications on the Internet (<https://support.industry.siemens.com/cs/ww/en/pv/6ES7132-6HD01-0BB1/td?dl=en>).

Article number	6ES7132-6HD01-0BB1
<b>General information</b>	
Product type designation	RQ 4x120 VDC ... 230 VAC/5 A NO ST
HW functional status	From FS02
Firmware version	V0.0
• FW update possible	No
usable BaseUnits	BU type B0, B1
Color code for module-specific color identification plate	CC40
<b>Product function</b>	
• I&M data	Yes; I&M0 to I&M3
• Isochronous mode	No
<b>Engineering with</b>	
• STEP 7 TIA Portal configurable/integrated from version	V14
• STEP 7 configurable/integrated from version	V5.5 SP3
• PCS 7 configurable/integrated from version	V8.1 SP1
• PROFIBUS from GSD version/GSD revision	One GSD file each, Revision 3 and 5 and higher
• PROFINET from GSD version/GSD revision	GSDML V2.3
<b>Operating mode</b>	
• DQ	Yes
• DQ with energy-saving function	No
• PWM	No
• Oversampling	No
• MSO	No
<b>Redundancy</b>	
• Redundancy capability	Yes

## 6.1 Technical specifications

<b>Article number</b>	<b>6ES7132-6HD01-0BB1</b>
<b>Supply voltage</b>	
Rated value (DC)	24 V
permissible range, lower limit (DC)	19.2 V
permissible range, upper limit (DC)	28.8 V
Reverse polarity protection	Yes
<b>Input current</b>	
Current consumption (rated value)	55 mA; without load
<b>Output voltage</b>	
Rated value (AC)	230 V
<b>Power loss</b>	
Power loss, typ.	1.5 W
<b>Address area</b>	
<b>Address space per module</b>	
• Inputs	+ 1 byte for QI information
• Outputs	1 byte
<b>Hardware configuration</b>	
Automatic encoding	Yes
• Mechanical coding element	Yes
• Type of mechanical coding element	type C
<b>Selection of BaseUnit for connection variants</b>	
• 2-wire connection	BU type B1
• 3-wire connection	BU type B0
<b>Digital outputs</b>	
Type of digital output	Relays
Number of digital outputs	4
Current-sinking	Yes
Current-sourcing	Yes
Digital outputs, parameterizable	Yes
Short-circuit protection	No
<b>Parallel switching of two outputs</b>	
• for logic links	Yes
• for uprating	No
• for redundant control of a load	Yes
<b>Switching frequency</b>	
• with resistive load, max.	2 Hz
• with inductive load, max.	0.5 Hz
• on lamp load, max.	2 Hz
<b>Total current of the outputs</b>	
• Current per channel, max.	5 A
• Current per module, max.	20 A

<b>Article number</b>	<b>6ES7132-6HD01-0BB1</b>
<b>Total current of the outputs (per module)</b>	
<b>horizontal installation</b>	
– up to 50 °C, max.	20 A
– up to 60 °C, max.	16 A
<b>vertical installation</b>	
– up to 40 °C, max.	20 A
– up to 50 °C, max.	16 A
<b>Relay outputs</b>	
• Number of relay outputs	4
• Rated supply voltage of relay coil L+ (DC)	24 V
• Current consumption of relays (coil current of all relays), max.	40 mA
• external protection for relay outputs	Yes, with miniature fuse max. 6 A tripping current and quick-response tripping characteristic
• Number of operating cycles, max.	7 000 000; see additional description in the manual
<b>Switching capacity of contacts</b>	
– with inductive load, max.	2 A; see additional description in the manual
– with resistive load, max.	5 A; see additional description in the manual
– Thermal continuous current, max.	5 A; Max. 1 385 VA, 150 W
– Switching current, min.	100 mA; 5 V DC
– Rated switching voltage (DC)	24 V DC to 120 V DC
– Rated switching voltage (AC)	24V AC to 230V AC
<b>Cable length</b>	
• shielded, max.	1 000 m
• unshielded, max.	200 m
<b>Interrupts/diagnostics/status information</b>	
Diagnostics function	Yes
Substitute values connectable	Yes
<b>Alarms</b>	
• Diagnostic alarm	Yes
<b>Diagnostic messages</b>	
• Monitoring the supply voltage	Yes
• Wire-break	No
• Short-circuit	No
<b>Diagnostics indication LED</b>	
• Monitoring of the supply voltage (PWR-LED)	Yes; green PWR LED
• Channel status display	Yes; green LED
• for channel diagnostics	No

## 6.1 Technical specifications

<b>Article number</b>	<b>6ES7132-6HD01-0BB1</b>
<ul style="list-style-type: none"> <li>for module diagnostics</li> </ul>	Yes; green/red DIAG LED
<b>Potential separation</b>	
<b>Potential separation channels</b>	
<ul style="list-style-type: none"> <li>between the channels</li> </ul>	Yes
<ul style="list-style-type: none"> <li>between the channels and backplane bus</li> </ul>	Yes
<ul style="list-style-type: none"> <li>between the channels and the power supply of the electronics</li> </ul>	Yes
<b>Permissible potential difference</b>	
between channels and backplane bus/supply voltage	240 V AC
<b>Isolation</b>	
Isolation tested with	2 500 V DC (type test)
<b>tested with</b>	
<ul style="list-style-type: none"> <li>between channels and backplane bus/supply voltage</li> </ul>	2 500 V DC
<ul style="list-style-type: none"> <li>between backplane bus and supply voltage</li> </ul>	707 V DC (type test)
<b>Standards, approvals, certificates</b>	
Suitable for safety functions	No
<b>Ambient conditions</b>	
<b>Ambient temperature during operation</b>	
<ul style="list-style-type: none"> <li>horizontal installation, min.</li> </ul>	-30 °C
<ul style="list-style-type: none"> <li>horizontal installation, max.</li> </ul>	60 °C
<ul style="list-style-type: none"> <li>vertical installation, min.</li> </ul>	-30 °C
<ul style="list-style-type: none"> <li>vertical installation, max.</li> </ul>	50 °C
<b>Altitude during operation relating to sea level</b>	
<ul style="list-style-type: none"> <li>Installation altitude above sea level, max.</li> </ul>	2 000 m; On request: Installation altitudes greater than 2 000 m
<b>Dimensions</b>	
Width	20 mm
Height	73 mm
Depth	58 mm
<b>Weights</b>	
Weight, approx.	40 g

## Derating trend

The following figure show the load current derating with horizontal and vertical mounting positions.

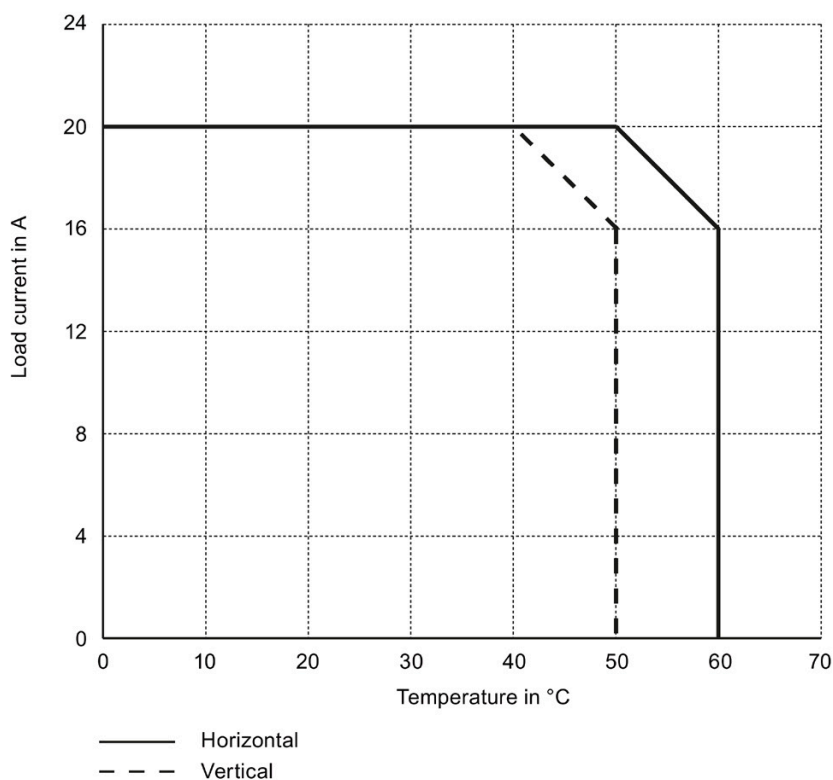


Figure 6-1 Load current and mounting position

## Dimension drawing

See the manual ET 200SP BaseUnits

(<https://support.automation.siemens.com/WW/view/en/58532597/133300>)



## 6.2 Switching cycles

### Switching capacity and lifetime of the contacts

With an external protective circuit, the contacts will last longer than specified in the table. This table shows the switching capacity and lifetime of the relay contacts:

Table 6- 1 Switching capacity and lifetime of the relay contacts

Resistive load	Voltage	Current	Switching cycles (typical)
For resistive load	24 VDC	5.0 A	0.1 million
		4.0 A	0.2 million
		2.0 A	0.5 million
		1.0 A	1.6 million
		0.5 A	4 million
		0.1 A	7 million
	60 VDC	0.5 A	1.6 million
	120 VDC	0.2 A	1.6 million
	48 VAC	2.0 A	1.6 million
	60 VAC	2.0 A	1.2 million
	120 VAC	5.0 A	0.1 million
		3.0 A	0.2 million
		2.0 A	0.4 million
		1.0 A	0.8 million
		0.5 A	1.5 million
	230 VAC	5.0 A	0.1 million
		3.0 A	0.2 million
		2.0 A	0.4 million
		1.0 A	0.8 million
		0.5 A	1.5 million
For inductive load in accordance with IEC 947-5-1 DC 13/ AC15	24 VDC	2.0 A	0.1 million
		1.0 A	0.2 million
		0.5 A	0.5 million
	60 VDC	0.5 A	0.2 million
	120 VDC	0.2 A	0.5 million
	48 VAC	1.0 A	0.7 million
	60 VAC	1.0 A	0.5 million
	120 VAC	2.0 A	0.1 million
		1.0 A	0.3 million
		0.5 A	1 million
		0.1 A	2 million
For inductive load in accordance with IEC 947-5-1 DC 13/ AC15	230 VAC	2.0 A	0.1 million
		1.0 A	0.3 million
		0.5 A	1 million

## Parameter data record

### A.1 Parameter assignment and structure of the parameter data record

The data record of the module has an identical structure, regardless of whether you configure the module with PROFIBUS DP or PROFINET IO. With data record 128, you can reconfigure the module in your user program regardless of your programming. This means that you can use all the functions of the module even if you configured it via PROFIBUS-GSD.

#### Parameter assignment in the user program

You have the option to reconfigure the module in RUN (e.g. the response of selected channels to the CPU-STOP state can be changed in RUN without having an effect on the other channels).

#### Changing parameters in RUN

The "WRREC" instruction is used to transfer the parameters to the module using data record 128. The parameters set in STEP 7 are not changed in the CPU, which means that the parameters set in STEP 7 will be valid again after a restart.

#### Output parameter STATUS

If errors occur when transferring parameters with the "WRREC" instruction, the module continues operation with the previous parameter assignment. The STATUS output parameter contains a corresponding error code.

You will find a description of the "WRREC" instruction and the error codes in the STEP 7 online help.

## Structure of data record 128

### Note

Channel 0 includes the diagnostics enable for the entire module.

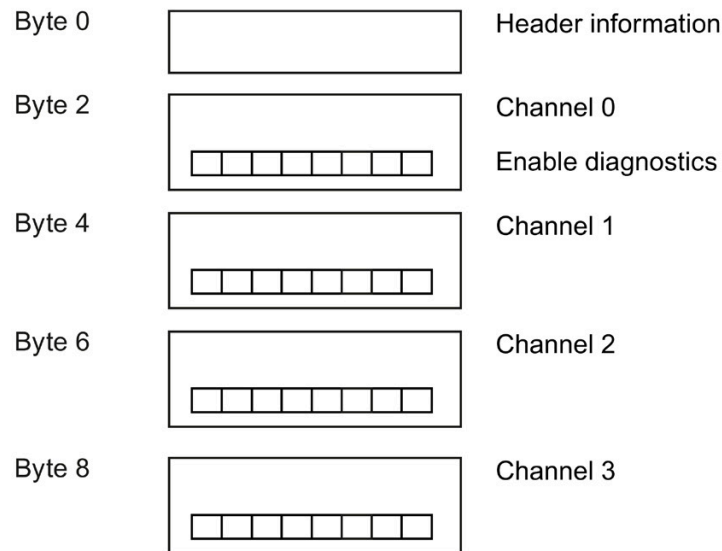


Figure A-1 Structure of data record 128

## Header information

The figure below shows the structure of the header information.


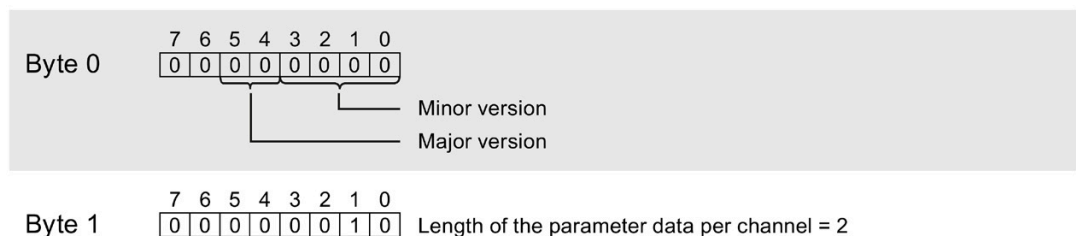


Figure A-2 Header information

## Parameters

The figure below shows the structure of the parameters in data record 128.

You enable a parameter by setting the corresponding bit to "1".

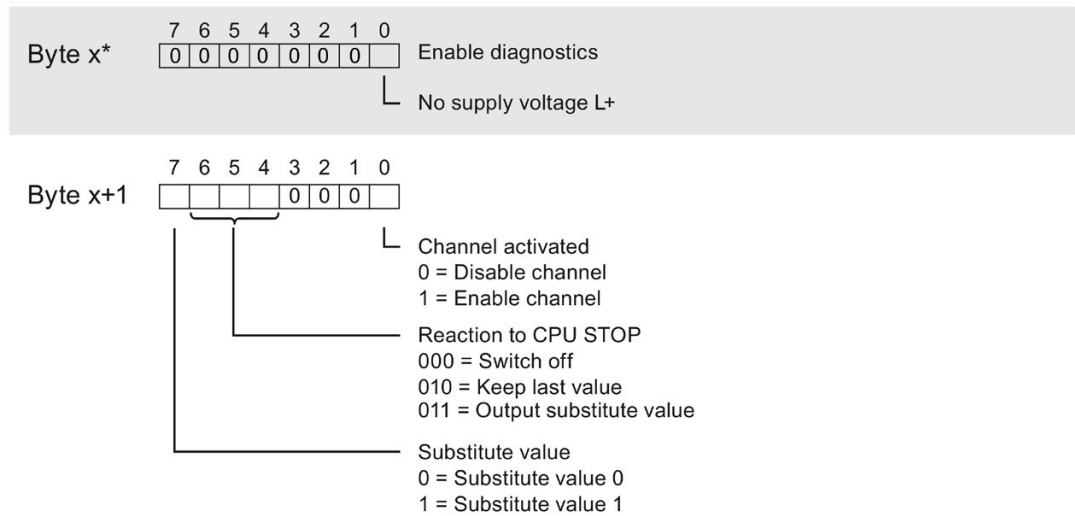

\*  $x = 2 + (\text{channel number} \times 2)$ ; channel number = 0 to 3

Figure A-3 Structure byte x to x+1 for the channels 0 to 3

## Error transferring the data record

The module always checks all the values of the transferred data record. Only if all the values were transferred without errors does the module apply the values from the data record.

The WRREC instruction for writing data records returns corresponding error codes when errors occur in the STATUS parameter. (See also the description of the "STATUS" parameter in the STEP 7 online help).

The following table shows the module-specific error codes and their meaning for the parameter data record 128.

Error code in STATUS parameter (hexadecimal)				Meaning	Solution
Byte 0	Byte 1	Byte 2	Byte 3		
DF	80	B0	xx	Number of the data record unknown.	Enter a valid number for the data record.
DF	80	B1	xx	Length of the data record incorrect.	Enter a valid value for the data record length.
DF	80	B2	xx	Slot invalid or cannot be accessed.	<ul style="list-style-type: none"> <li>Check the station whether the module is plugged or drawn.</li> <li>Check the assigned values for the parameters of the WRREC instruction.</li> </ul>
DF	80	E0	xx	Wrong version or error in the header information.	Correct the version, length and number of parameter blocks.
DF	80	E1	06	Invalid coding for substitute value behavior.	Check the parameters of the module.

